


OVERHEAD METER LOOP REQUIREMENTS

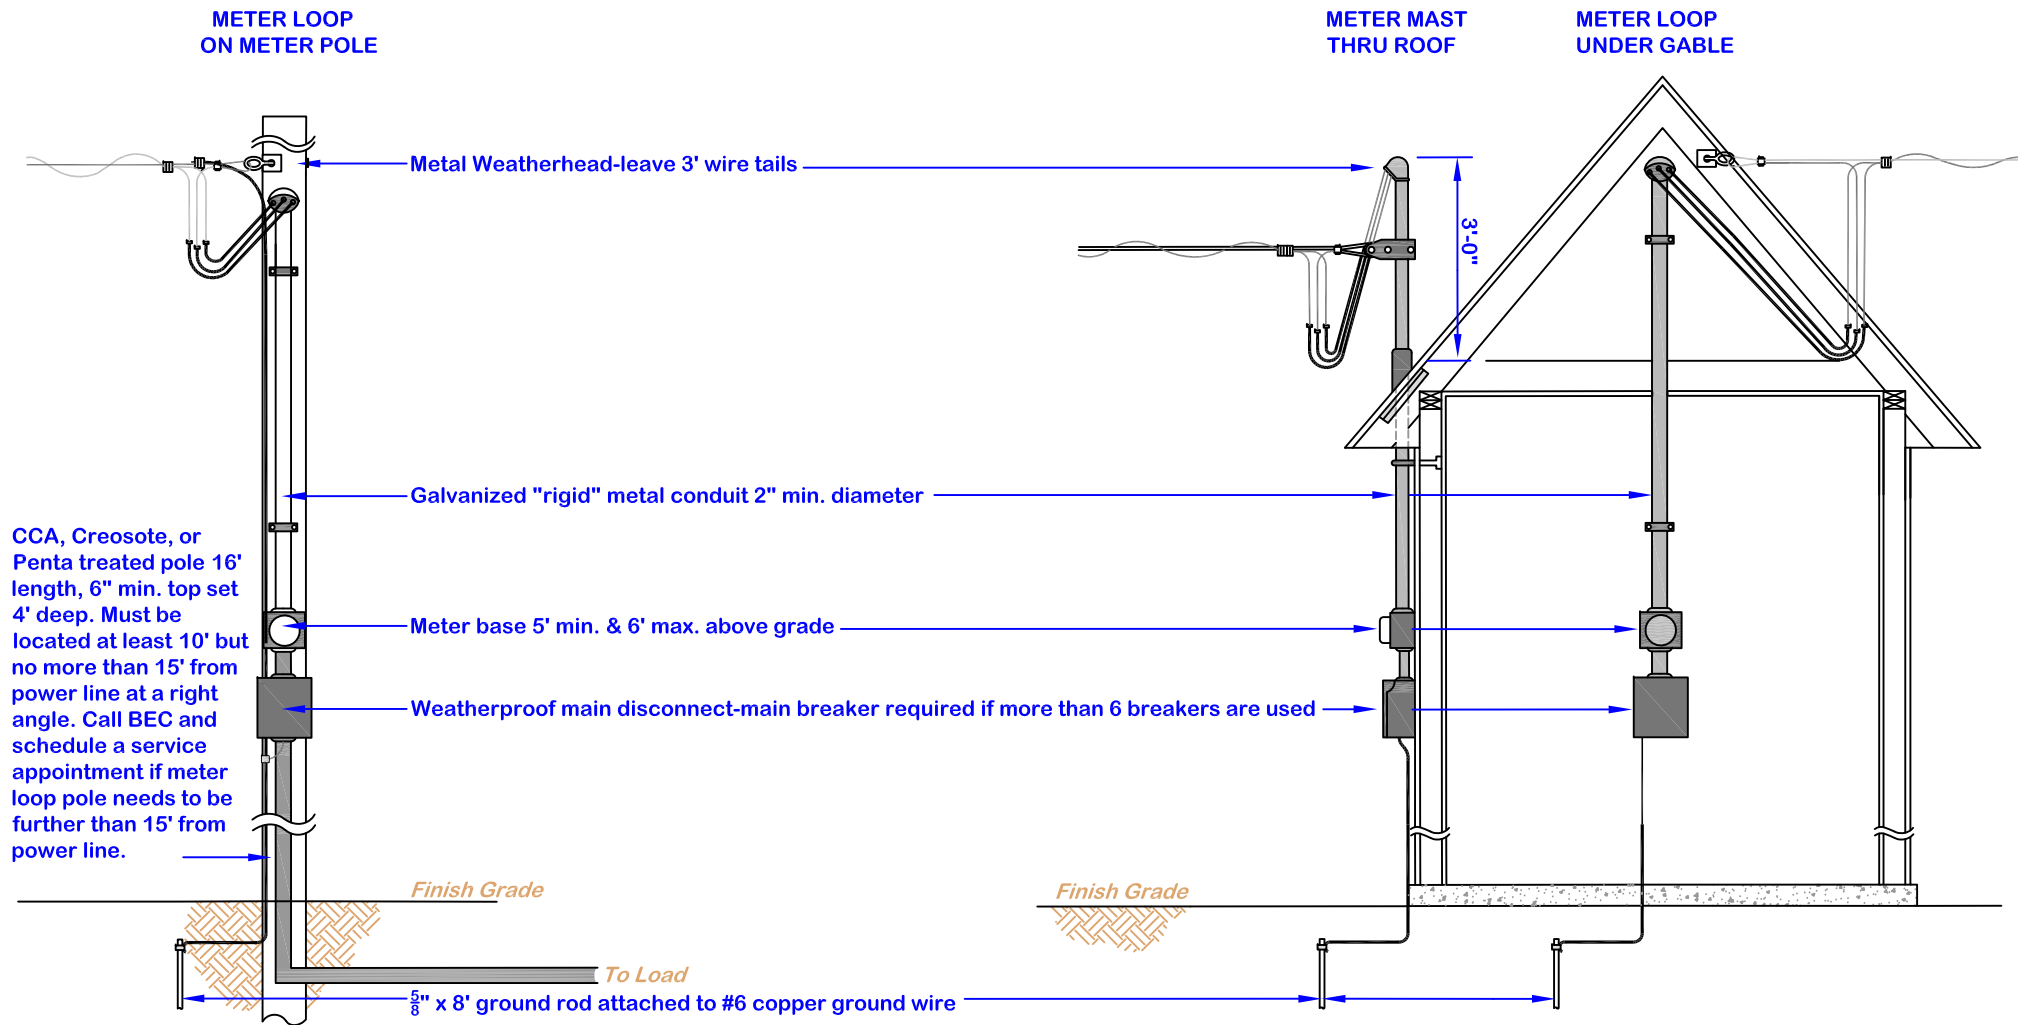

NOTES:
 All wiring must conform to National Electric Code, National Electrical Safety Code, and Municipal Code as required.
 Municipal jurisdiction will require city inspection of loop before connection.
 Addition of future load should be considered when sizing meter loop.
 Minimum wire size for: 100amp meter loop- #2 cooper
 200amp meter loop-2/0 cooper
 other-contact office

Mark neutral with white tape or stripped insulation
 Minimum height 12' finish grade to service wire attachment in non vehicular traffic areas.
 Meter loops not allowed on mobile homes.

N.T.S.
 comb-meterloop-rev122111.dwg
 Approved: KS

Bartlett Electric Cooperative, Inc.
 27492 Hwy 95
 P O Box 200
 Bartlett, TX 76511

254-527-3551
 (Fax) 254-527-3221