


**NOTES:**

1. Main disconnect panel may not be used as an electrical race way.
2. Line taps shall be made by the electrical contractor if a galvanized wiring trough is used.
3. Weatherproof fittings required.
4. Two (2) disconnects can be substituted with (1) fused disconnect.
5. Notify the Bartlett Electric Cooperative when meter assembly is complete.
6. Wire sized to total disconnect(s) size.
7. Neutral(s) may only be reduced one size on residential application. No reduction of the neutral(s) is allowed on commercial application.
8. Point of attachment for Co-op's service conductor to be provided by electrical contractor.
9. Minimum height 12' finish grade to service wire attachment in non vehicular traffic areas.



FOR THE MEMBER'S SAFETY,  
WIRING INSTALLATIONS SHALL  
CONFORM TO THE REQUIREMENTS  
OF THE NEC AND NESC.

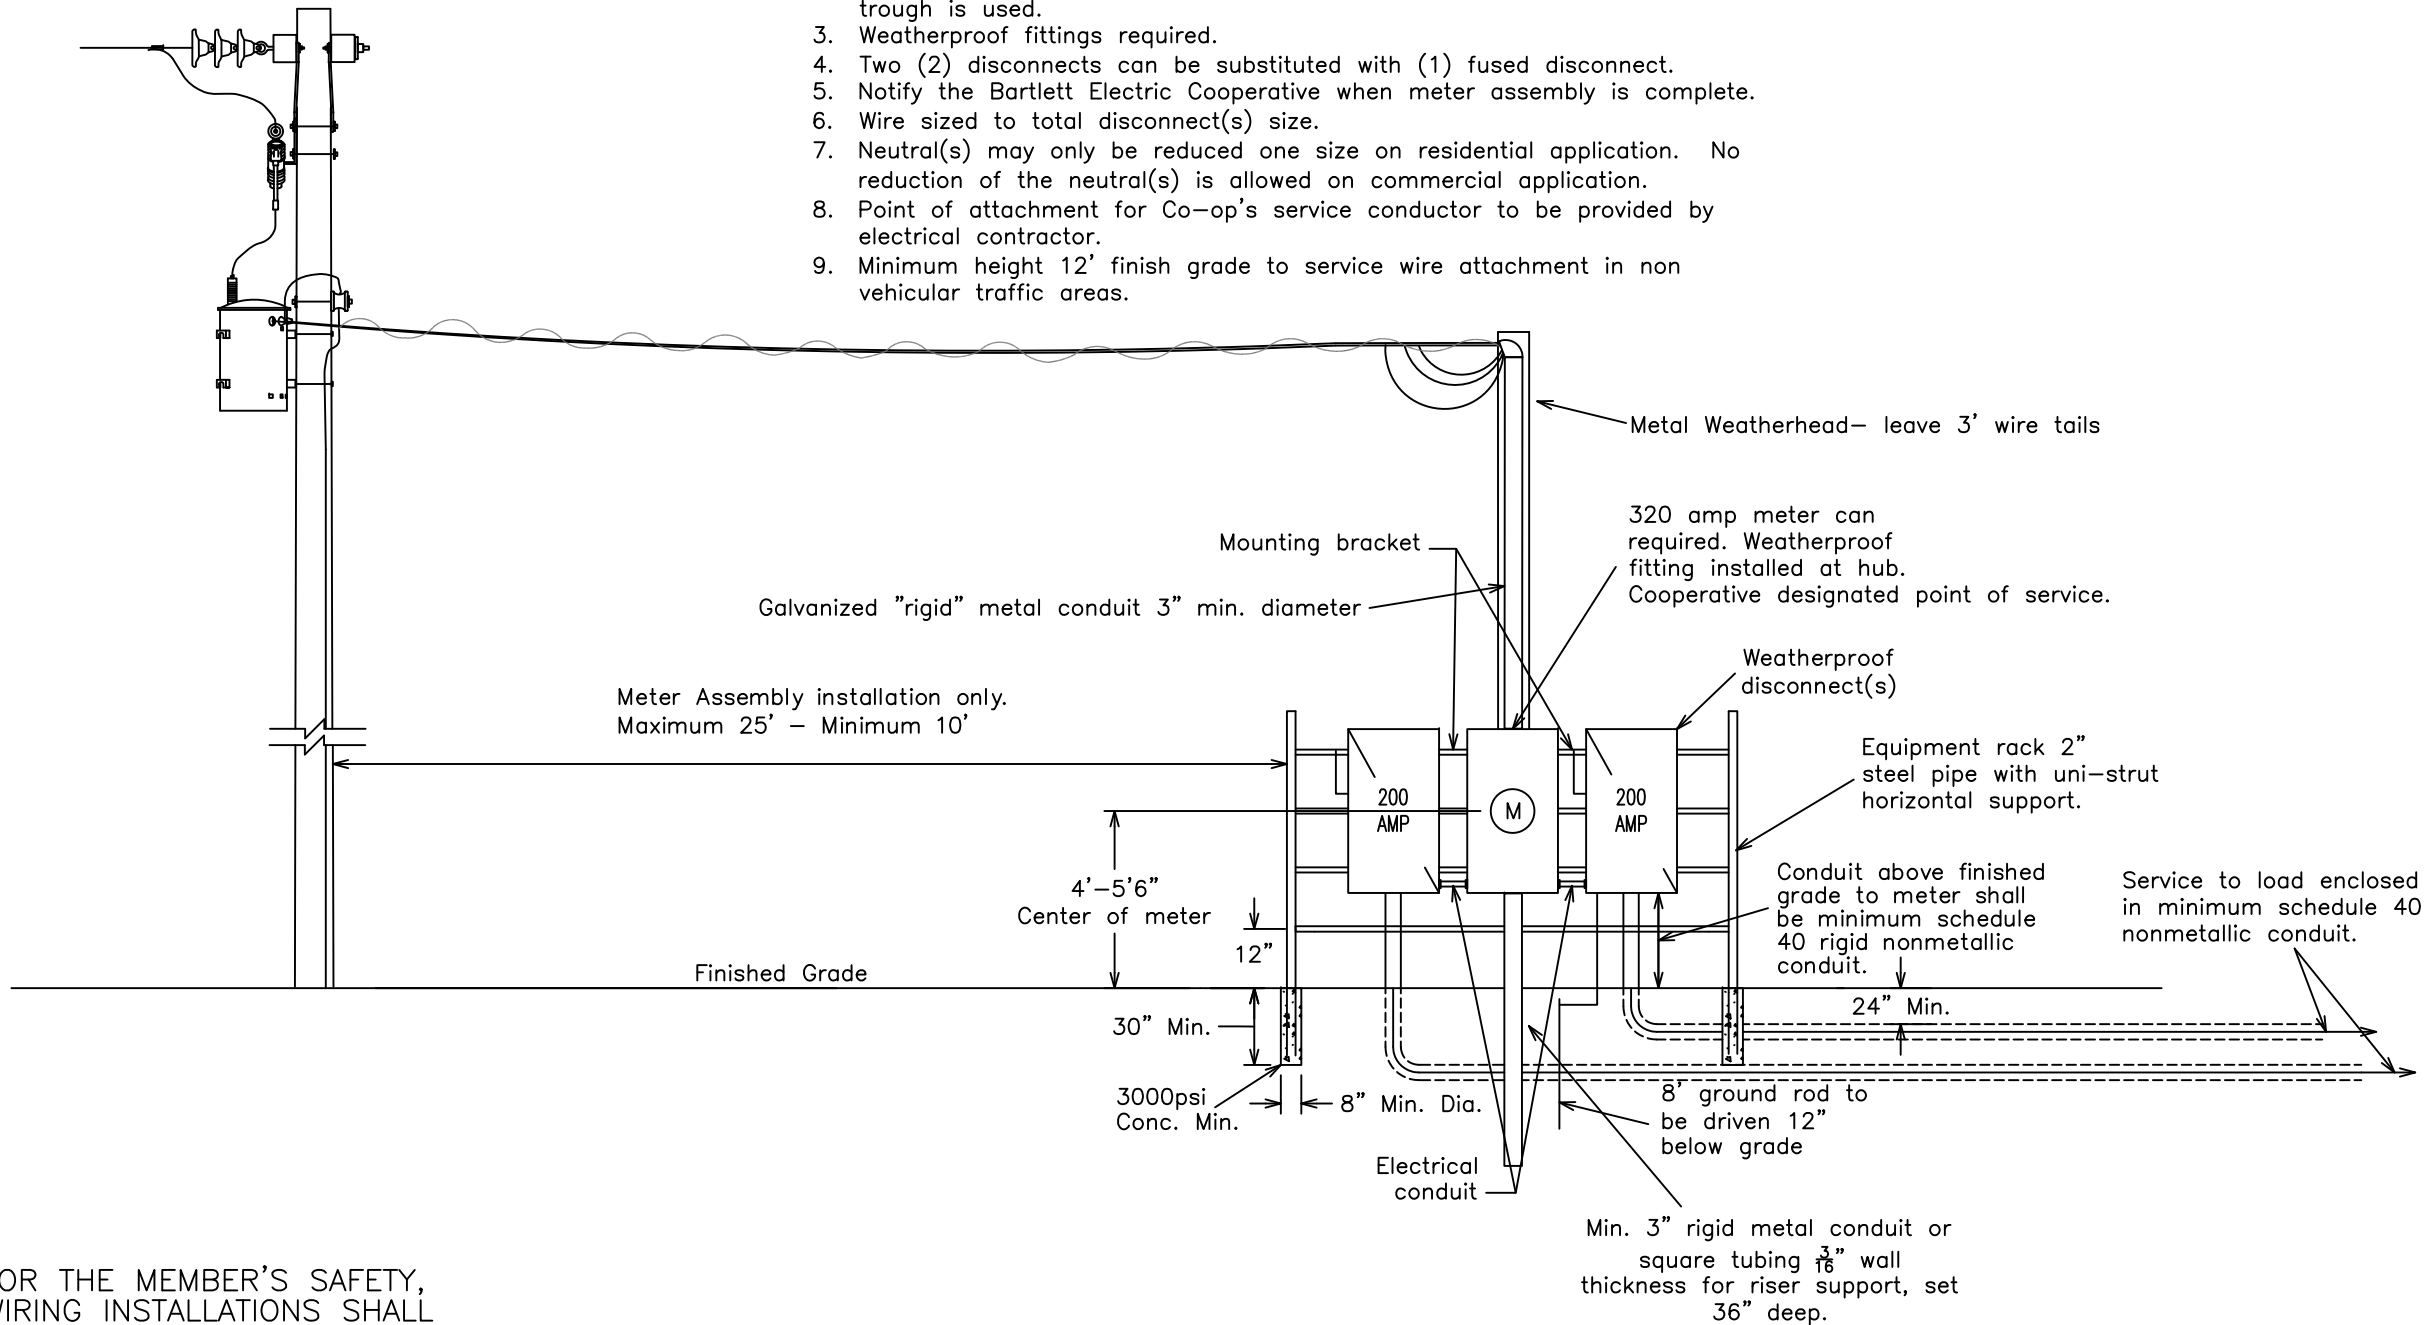

**BEC Power**  
27492 HWY 95  
Bartlett, Texas 76511

**1Ø, 320 AMP OVERHEAD SERVICE ON A  
RACK FROM OVERHEAD WITH CLASS 320  
METER SOCKET, 1 OR 2 DISCONNECTS**

Drawn By: SEP	Checked By: GP	Approved By: KGS	Revised by: SE
Scale: N.T.S.	Date: 08-03-21	Drawing #: BEC-MS-1	Date: 08/03/21