


NOTES:

1. Weatherproof fittings required.
2. Notify the Bartlett Electric Cooperative when meter assembly is complete.
3. Wire sized to total disconnect size.
4. Neutral may only be reduced one size on residential application. No reduction of the neutral is allowed on commercial application.
5. Bartlett Electric Cooperative pole must remain free of structures and private attachments other than meter loop riser assembly.
6. Member will provide ditch and cover ditch from rack to pole.
7. Member will provide 2" sch. 40 PVC conduit from pole to rack. Sweeps shall be a minimum 18" 90°.
8. Bartlett will provide wire from pole to meter assembly.



FOR THE MEMBER'S SAFETY,
WIRING INSTALLATIONS SHALL
CONFORM TO THE REQUIREMENTS
OF THE NEC AND NESC.

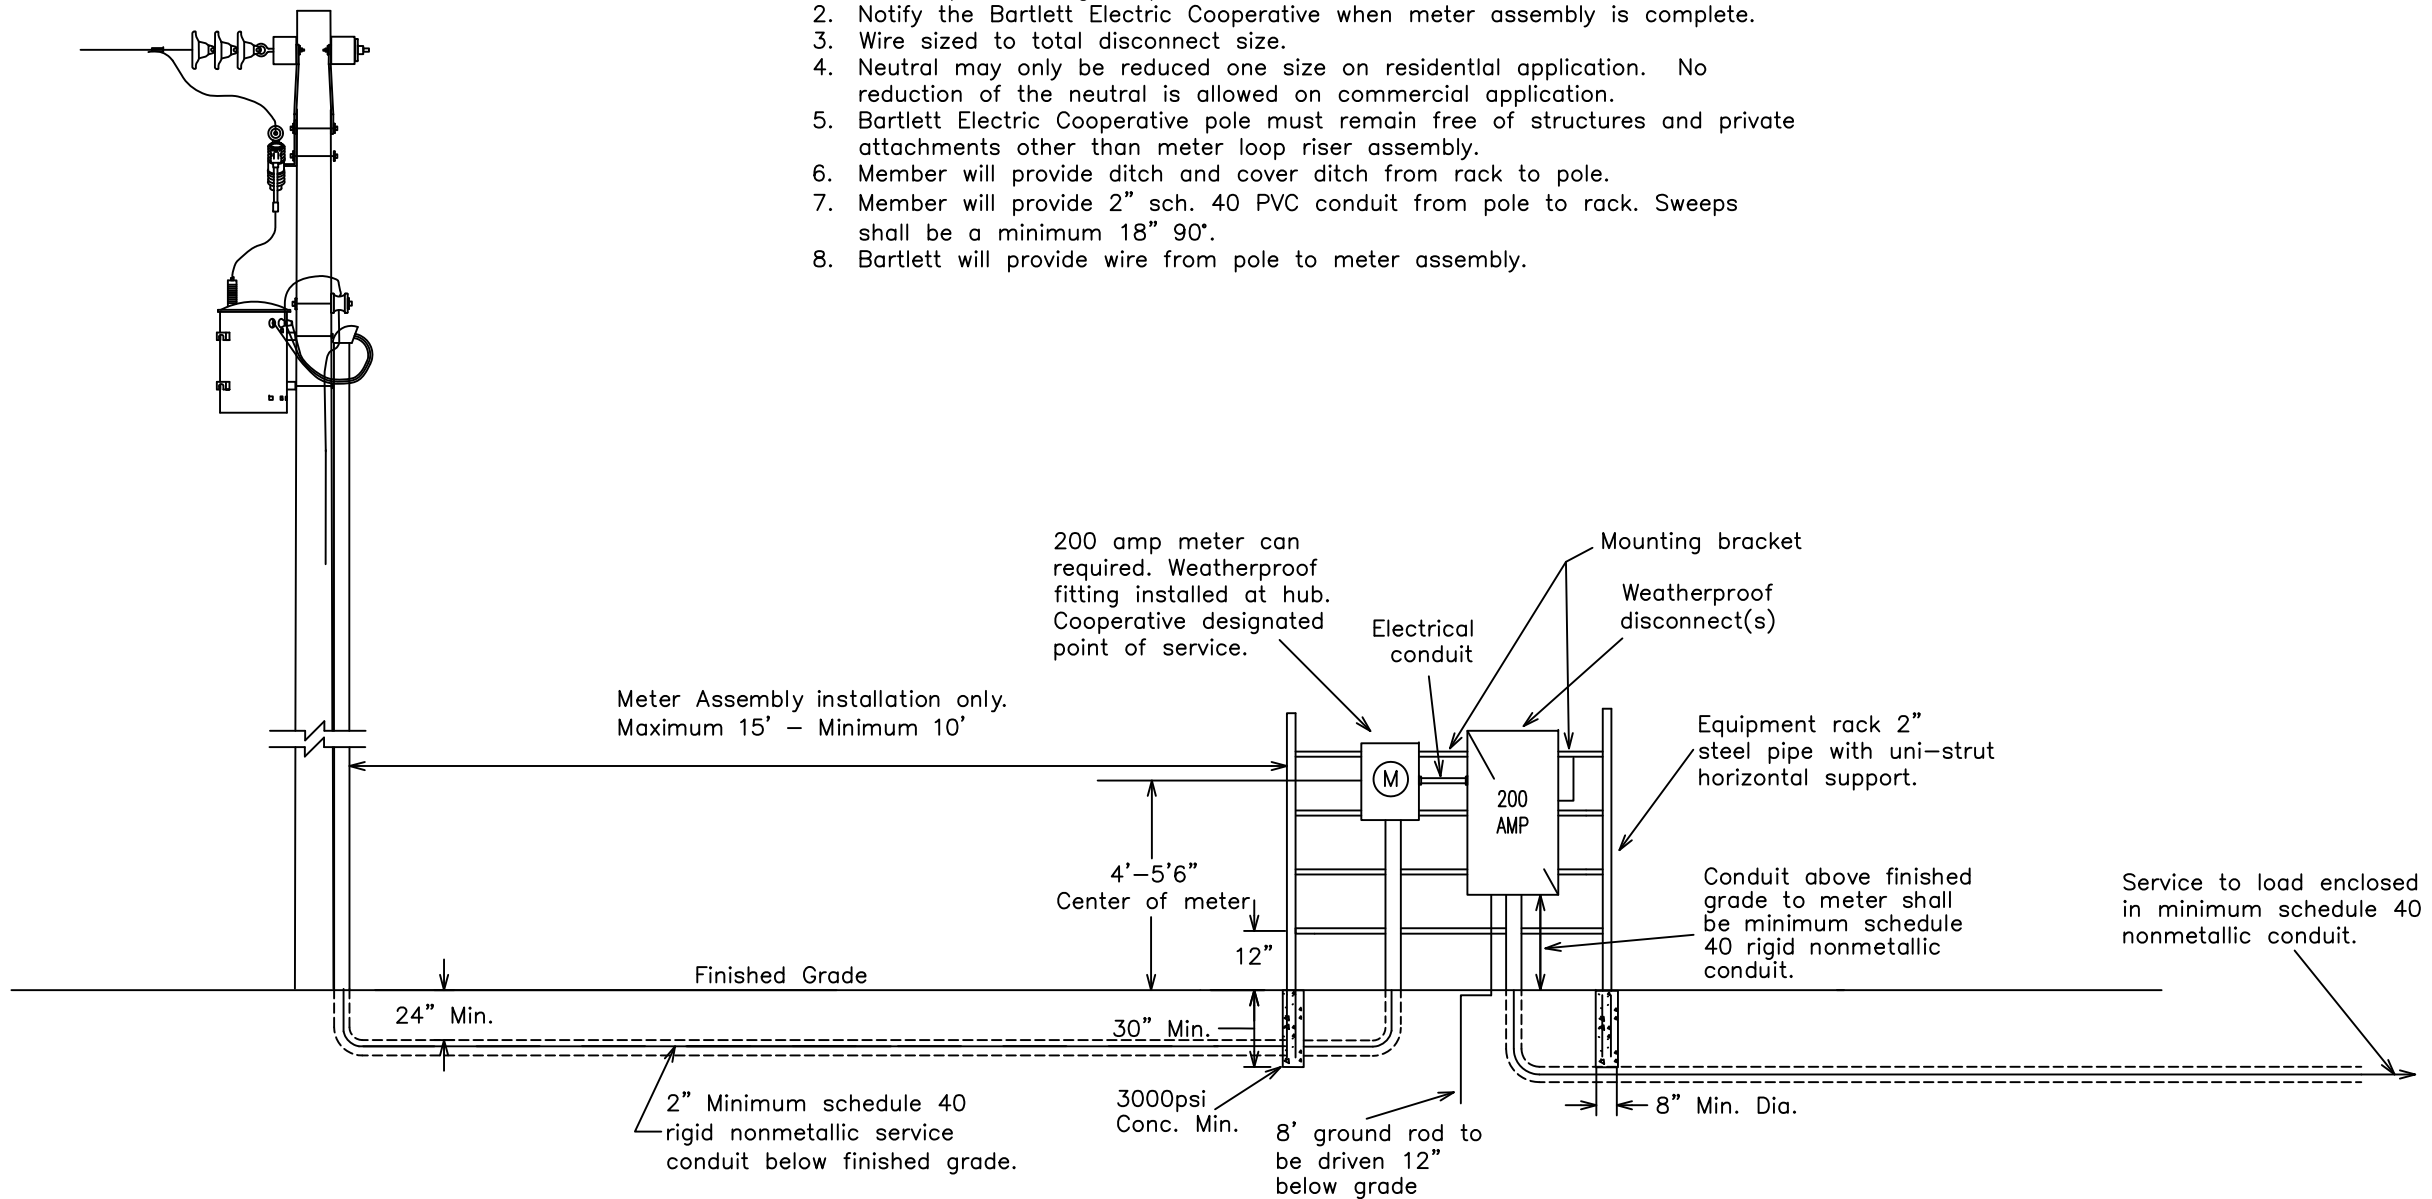

BEC Power
27492 HWY 95
Bartlett, Texas 76511

1Ø, 200 AMP URD SERVICE ON
RACK FROM OVERHEAD WITH CLASS
200 METER SOCKET

Drawn By: SEP	Checked By: GP	Approved By: KGS	Revised by: SE
Scale: N.T.S.	Date: 08-03-21	Drawing #: BEC-MS-10	Date: 08-03-21